



150mm
100
50
10mm
0

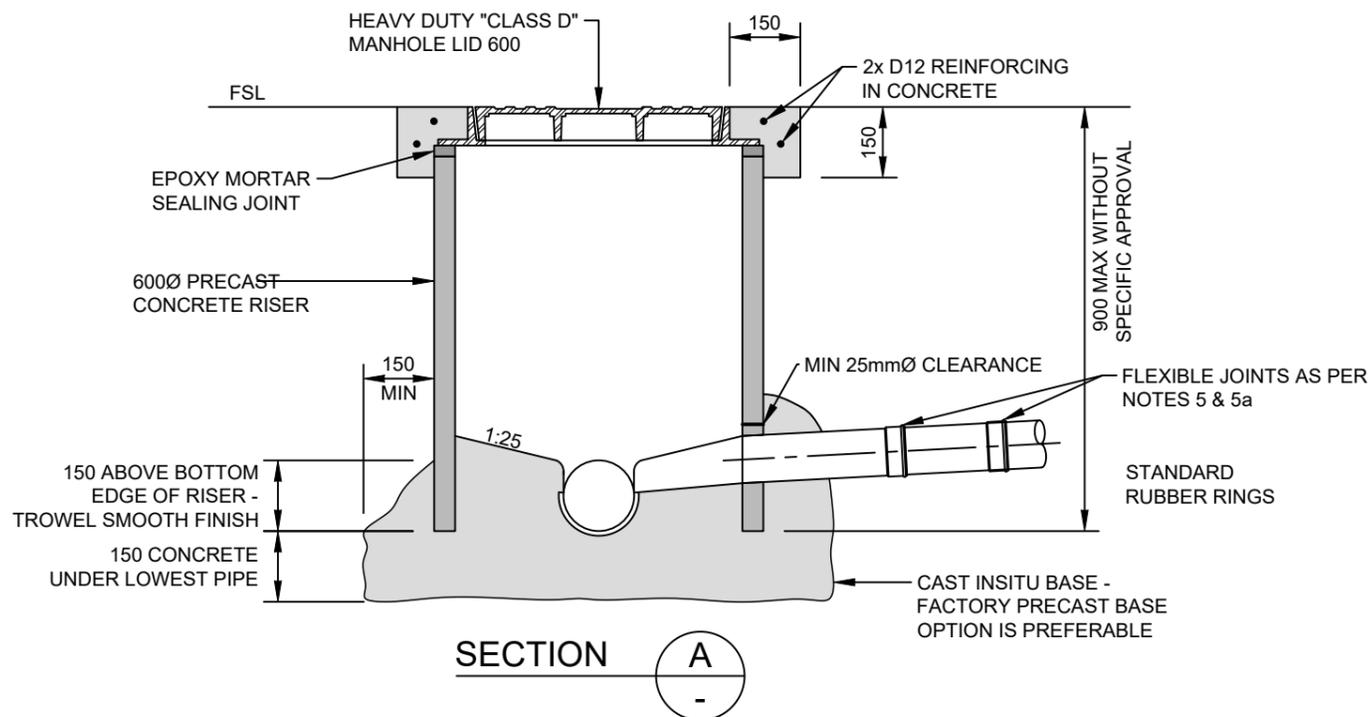

NOTE:

1. ALL DIMENSIONS IN MILLIMETRES.
2. MINI-MANHOLES ARE NOT TO BE USED ON PIPES OF GREATER DIAMETER THAN 150.
3. ONLY 100mm DIAMETER SERVICE CONNECTIONS INTO MINI MANHOLES. A PERMITTED LIMIT OF TWO CONNECTIONS.
4. ACCESS HOLES TO BE 600.
5. DOUBLE FLEXIBLE JOINTS, TWO WITHIN 750mm OF MANHOLES, TO BE INSTALLED WITH SN16 PVC PIPES.
- 5A. ONE FLEXIBLE JOINT ONE WITHIN 750mm OF MANHOLES TO BE INSTALLED WITH CONCRETE PIPES
6. POINTING BETWEEN CHANNEL HOLES SHALL BE DONE USING EPOXY MORTAR.
7. MIN COVER 900mm ON GRAVITY SEWERMAINS IN CARRIAGEWAY

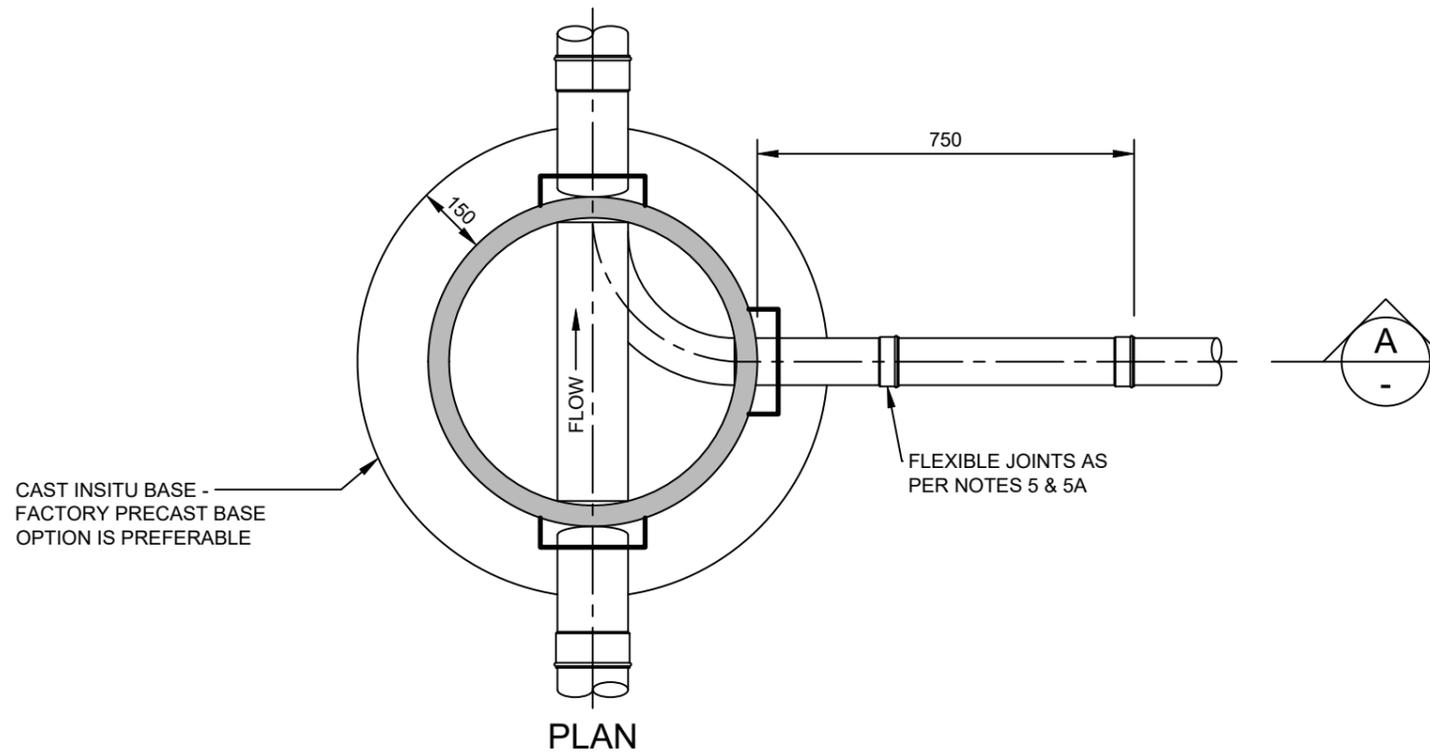

STANDARD DETAILS

**MANHOLES
PRECAST MINI-MANHOLES**

Drawn	J. GOODMAN	Designed	KCDC
Approved	B. MAGUIRE	Revision Date	OCTOBER 2020
Scale	NOT TO SCALE	Drawing No.	HDC-CM-007
		Revision	R0