




150mm
100
50
10mm
0

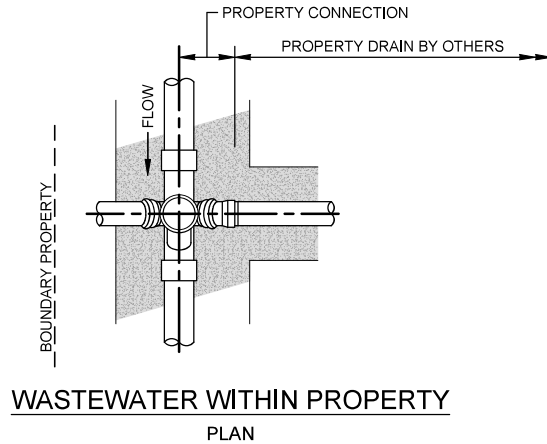


WASTEWATER WITHIN PROPERTY
PLAN

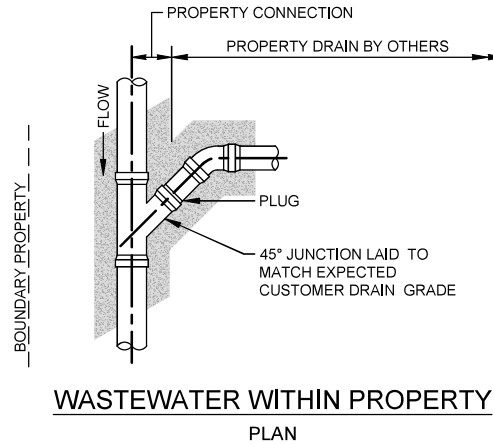


WASTEWATER WITHIN PROPERTY
PLAN

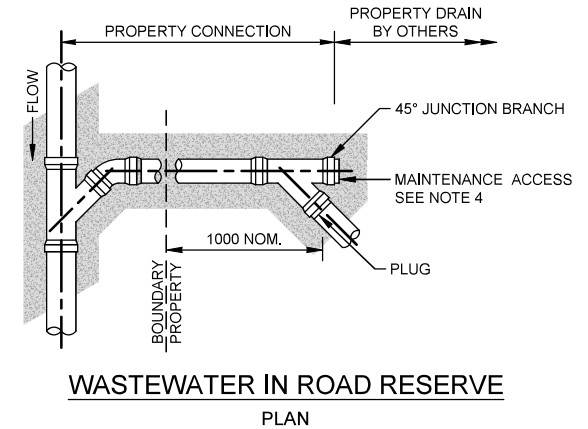


WASTEWATER IN ROAD RESERVE
PLAN

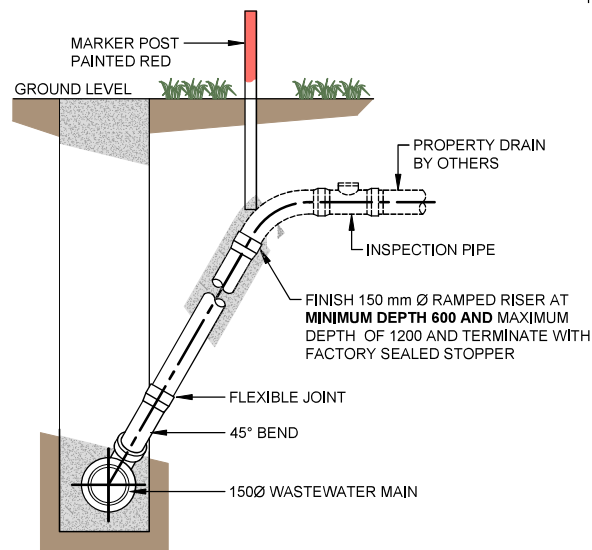


Y JUNCTION RAMPED RISERS
ELEVATION

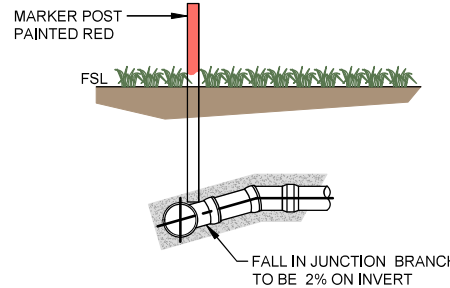

STANDARD CONNECTION
ELEVATION

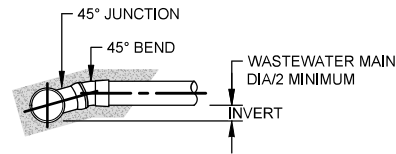

**MINIMUM LEVEL
STANDARD CONNECTION**

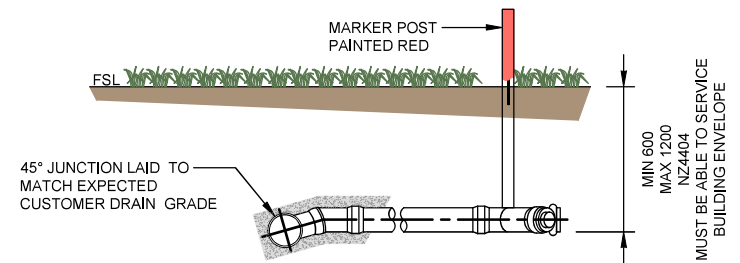

EXTENDED CONNECTION
ELEVATION
(MAY ALSO BE INSTALLED AS A SLOPED CONNECTION)

NOTE:

1. ALL DIMENSIONS IN MILLIMETRES.
2. ALL CONNECTION TYPES SHOWN IN THIS DRAWING ARE APPLICABLE TO PVC.
3. LAY PROPERTY DRAIN CONNECTION AT DEPTH **MINIMUM OF 600 AND MAXIMUM DEPTH 1200**. MUST BE ABLE TO SERVICE BUILDING ENVELOPE
4. RODDING POINTS REQUIRED **AT BOUNDARY ON PROPERTY CONNECTION**.
5. GRADE OF PROPERTY CONNECTION WASTEWATER PIPE TO BE NOT LESS THAN: DN 100 1.65 %
DN 150 1.2 %
6. **ALL PUBLIC DRAINAGE TO BE AS/NZS1260 SN16**

© Copyright Standards New Zealand 2011. Drawings from NZS 4404:2010 have been reproduced with permission from Standards New Zealand under Copyright Licence 000904. Refer to the complete Standard available for purchase from Standards New Zealand.
HDC AMENDMENTS TO NZS 4404:2010 SHOWN IN **BOLD**.

Horowhenua
DISTRICT COUNCIL

STANDARD DETAILS

**PROPERTY CONNECTIONS
BURIED INTERFACE METHOD**

Drawn	J. GOODMAN	Designed	KCDC
Approved	B. MAGUIRE	Revision Date	OCTOBER 2020
Scale	NOT TO SCALE	Drawing No.	HDC-WW-002
		Revision	R0